E30 & E31 SERIES

Monitor Entire Panelboards with One Device





F3xA/B/C

Integrated Ethernet with SNMP, BACnet, & Modbus

The E30 & E31 Series Panelboard Monitoring System provides a cost effective solution for electrical load management, making it ideally suited for applications where loads are dynamic, such as the data storage industry, lighting panels, etc.

The E30 & E31 Series monitors the current, voltage, instantaneous power, demand, and energy consumption of each circuit in a panelboard including the main feed.* As a circuit approaches the userconfigured thresholds, alarm indicators are triggered, preventing costly downtime from overloaded circuits or failed loads. (See graph, facing

* E3xB/C models have less capability.

SPECIFICATIONS

| INPUTS | |
|---------------------|--|
| Input Power | E3xA/B/C: 90 to 277 Vac line-to-neutral, 50/60 Hz, 8 VA E3xE: 100 to 277 Vac line-to-neutral, 50/60 Hz, 15 VA |
| ACCURACY | |
| Power/Energy | IEC 62053-21 Class 1, ANSI C12.1-2008. 1% system accuracy (includes main board and 50 A or 100 A branch CTs) |
| Voltage | ±0.5% of reading 90 to 277 Vac line-to-neutral |
| Current | ±0.5% of reading |
| Minimum ON Current | 50 mA |
| OPERATION | |
| Sampling Frequency | 2560 Hz |
| Update Rate | 2 seconds (both panels) |
| Overload Capability | 22 kAIC |
| OUTPUTS | |
| Serial Protocols | All: Modbus RTU E3xE models: BACnet MSTP |
| Serial Connection | All: 2-wire, RS-485 E3xA/B/C models: 4-wire RS-485 |
| Address | E3xA/B/C models: Selectable address 1 to 247 (uses 2 addresses for Modbus RTU) E3xE models: Selectable at address 1 to 247 for Modbus RTU; 0 to 127 for BACnet MS/TP |
| Baud Rate | All: 9600, 19200, 38400 (selectable on A/B/C models) |

Revenue grade

ANSI and IEC Class 1 metering system accuracy including branch CTs

50 mA to 100 A

Widest dynamic range in the industry, 50 mA to 100 A monitoring

Versatility

Flexible installation with 3/4", 1", or 18 mm spaced solid-core branch CT strips

Retrofit or new construction

New construction and retrofit applications with solid-core and split-core CT models

Up to 92 Channels

Monitor up to 92 circuits per unit providing unlimited possibilities for monitoring

Configure the meters you want

Choose 4, 8, 14 or 28 3-phase meters. User-configurable to any combination of 1-, 2-, 3-phase meters. Reconfigure channels as needed to monitor neutral current.

APPLICATIONS

- Load-based cost allocation
- Overload protection
- Data center PDUs
- Sub-tenant billing
- Lighting control panels
- Load management
- Load balancing
- **Energy management**

| Parity | All: Modbus RTU: NONE, ODD, EVEN (selectable on A/B/C models) E3xE models: BACnet MS/TP: NONE (fixed) | | |
|----------------------------|---|--|--|
| Terminal Block Torque | 4.4 to 5.3 in-lb (0.5 to 0.6 N-m) | | |
| Ethernet Protocols | All: Modbus TCP E3xE models: BACnet IP, SNMP V2c | | |
| Ethernet Connection | E3xE models only: RJ-45 10/100 Mbit | | |
| ENVIRONMENTAL | | | |
| Operating Range | 0 to 60 °C (32 to 140 °F) (<95% RH non-condensing)* | | |
| Storage Temp Range | -40 to 70 °C (-40 to 158 °F) | | |
| Altitude of Operation | 3000 m | | |
| WARRANTY | | | |
| Limited Warranty | 5 years | | |
| AGENCY APPROVALS | | | |

| Agency Approvals | UL508, EN61010-1, Cat. III, pollution degree 2 |
|------------------|--|
| Type Approval*** | California Code of Regulations, Title 4, Division 9, Article 1. National Uniformity Exceptions and Additions, 2016 edition |







^{*} Indoor use only.

^{**}The CE mark indicates RoHS2 compliance. Please refer to the CE Declaration of Conformity for additional details.

^{***}E30xxx (solid-core) models only.


PRODUCT CAPABILITIES

| | E3xA | E3xB | E3xC | E3xE |
|-------------------------------|------|------|------|------|
| MONITORING AT MAINS | | | | |
| Current per phase | • | • | • | • |
| Max. current per phase | • | • | • | • |
| Current demand per phase | • | • | • | • |
| Max. current demand per phase | • | • | • | • |
| Current phase angle | • | • | | • |
| Energy (kWh) per phase | • | • | | • |
| Real Power (kW) per phase | • | • | | • |
| Apparent Power (kVA) | • | • | | • |
| Power factor total* | • | • | | • |
| Power factor per phase | • | • | | • |
| Voltage, L-L and average | • | • | | • |
| Voltage, L-N and average | • | • | | • |
| Voltage, L-N and per phase | • | • | | • |
| Frequency (phase A) | • | • | | • |
| MONITORING AT BRANCH CIRCUIT | | | | |
| Current | • | • | • | • |
| Max. current | • | • | • | • |
| Current demand | • | • | • | • |
| Max. current demand | • | • | • | • |
| Current phase angle | • | | | • |
| Real power (kW) | • | | | • |
| Real power (kW) demand | • | | | • |
| Real power (kW) demand max. | • | | | • |
| Energy (kWh) per circuit | • | | | • |
| Power factor | • | | | • |
| Apparent Power (kVA) | • | | | • |
| MODBUS ALARMS | | | | |
| Voltage over/under | • | • | | • |
| Current over/under | • | • | • | • |
| PROTOCOLS SUPPORTED | | | | |
| Modbus RTU | • | • | • | • |
| Modbus TCP | ** | ** | ** | • |
| BACnet MS/TP | † | † | † | • |
| BACnet IP with BBMD support | † | † | † | • |
| SNMP V2 | ‡ | ‡ | ‡ | • |
| | | | | |

* Based on a 3-phase breaker rotation.


E30A/B/C & E31A/B/C MAIN BOARD

Dimensional Drawing

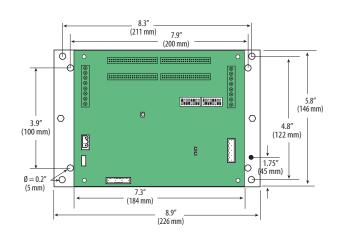


E30E & E31E

Dimensional Drawing

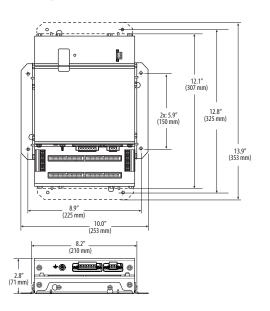

OPERATION EXAMPLE




^{**} With UO13-0012 or E8951 added.

[†] With E8951 added.

[‡] With E8951 added; requires one E8951 for each meter.



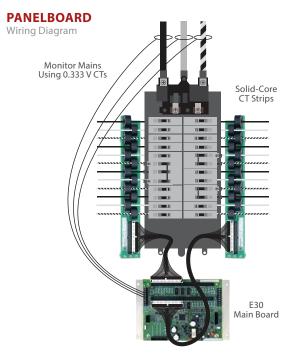

SOLID-CORE BRANCH CTs


| | 100 A SOLID-CORE BRANCH CT | | |
|----------------|----------------------------|--|--|
| Voltage Rating | 300 Vac | | |
| Temperature | 0 to 60 °C | | |
| Agency | EN61010-1 | | |




Observe precautions for handling static sensitive devices to avoid damage to the circuitry that is not covered under the factory warranty.

BRANCH CT STRIPS

Dimensional Drawing

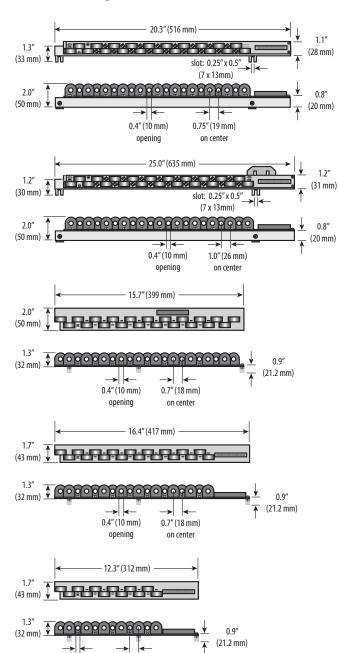

E30 (SOLID-CORE) ORDERING INFORMATION

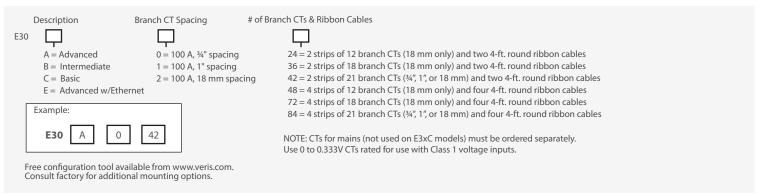

0.4" (10 mm)

opening

0.7" (18 mm)

on center

E31 (SPLIT-CORE) ORDERING INFORMATION

Boards

E31

Description # of CTs

A = Advanced board 002 = 2 adapter boards, no CTs, no cables

B = Intermediate board 004 = 4 adapter boards, no CTs, no cables 42 = 2 adapter boards, 42 50A CTs, 2 4 ft. round ribbon cables

C = Basic board 42 = 2 adapter boards, 42 50A CTs, 2 4 ft. round ribbon cables E = Advanced with Ethernet 84 = 4 adapter boards, 84 50A CTs, 4 4 ft. round ribbon cables

Y63 = 2 adapter boards, flat ribbon cables,

pre-assembled on one bracket, CTs not included (not available with E31E models)

2 Branch CTs (up to 21 CTs per adapter board)

Description

E31CT

0 = 6-pack, 50A Branch CT, 6 ft. (1.8 m) lead 3 = Single CT, 200A Branch CT, 0R20 = 6-pack, 50A Branch CT, 20 ft. (6 m) lead 6 ft. (1.8 m) lead

1 = 6-pack, 100A Branch CT, 6 ft. (1.8 m) lead 3R20 = Single CT, 200A Branch CT, 1R20 = 6-pack, 100A Branch CT, 20 ft. (6 m) lead 20 ft. (6 m) lead

3 Ribbon Cable (order 1 cable per adapter board)

Description

CBL0

 34 = Round Ribbon Cable, 1 ft. (0.3 m)
 08 = Flat Ribbon Cable, 18 in. (0.5 m)

 31 = Round Ribbon Cable, 18 in. (0.5 m)
 16 = Flat Ribbon Cable, 4 ft. (1.2 m)

 32 = Round Ribbon Cable, 30 in. (0.8 m)
 17 = Flat Ribbon Cable, 5 ft. (1.5 m)

 22 = Round Ribbon Cable, 4 ft. (1.2 m)
 18 = Flat Ribbon Cable, 5 ft. (1.5 m)

 33 = Round Ribbon Cable, 8 ft. (2.4 m)
 19 = Flat Ribbon Cable, 8 ft. (2.4 m)

 23 = Round Ribbon Cable, 10 ft. (3 m)
 20 = Flat Ribbon Cable, 10 ft. (3 m)

Ordering Examples:

Option A: For monitoring 42 or 84 circuits, order a pre-made kit from Group • only (see Application/Wiring Diagram above). Example: E31x42 or E31x84

Option B: For monitoring other configurations, build your own kit by selecting from Groups •, ②, and ③.

Example kit for an 18-circuit panel retrofit:

24 = Round Ribbon Cable, 20 ft. (6 m)

• E31A002 - Advanced board, 2 adapter boards (1 unit) • E31CT0 - 50A Branch CT six-pack (3 units)

2 E31CT0 - 50A Branch CT six-pack (3 units) 3 CBL023 - 10 ft. round ribbon cable (2 units)

NOTE: CTs for mains (not used on E3xC models) must be ordered separately.

Use 0 to 0.333 V CTs rated for use with Class 1 voltage inputs.





21 = Flat Ribbon Cable, 20 ft. (6 m)


E31xY63

SPLIT-CORE BRANCH CTs

| | 50 A SPLIT-CORE BRANCH CT | 100 A SPLIT-CORE BRANCH CT | 200 A SPLIT-CORE BRANCH CT |
|----------------------|--|--|--|
| Voltage Rating | 300 Vac | 300 Vac (CE), 600 Vac (UL) | 300 Vac (CE), 600 Vac (UL) |
| Measurement Range | 0 to 60 A | 0 to 120 A | 0 to 240 A |
| Temperature | 0 to 60 °C | 0 to 60 °C | 0 to 60 °C |
| Agency | UL 61010-1 Recognized, EN61010-1 | UL 61010-1 Recognized, EN61010-1 | UL 61010-1 Recognized, EN61010-1 |


E31 ADAPTER BOARD


Dimensional Drawing



BRANCH CTs

Dimensional Drawing






E31CT3 200 Amp (0 to 240 Amp Range)


A = 1.5" (39 mm) B = 1.25" (32 mm) C = 1.25" (32 mm) D = 2.5" (64 mm) E = 2.8" (71 mm)

E31XY63 BOARDS WITH BRACKET

Dimensional Drawing



WIRING DIAGRAM





Observe precautions for handling static sensitive devices to avoid damage to the circuitry that is not covered under the factory warranty.